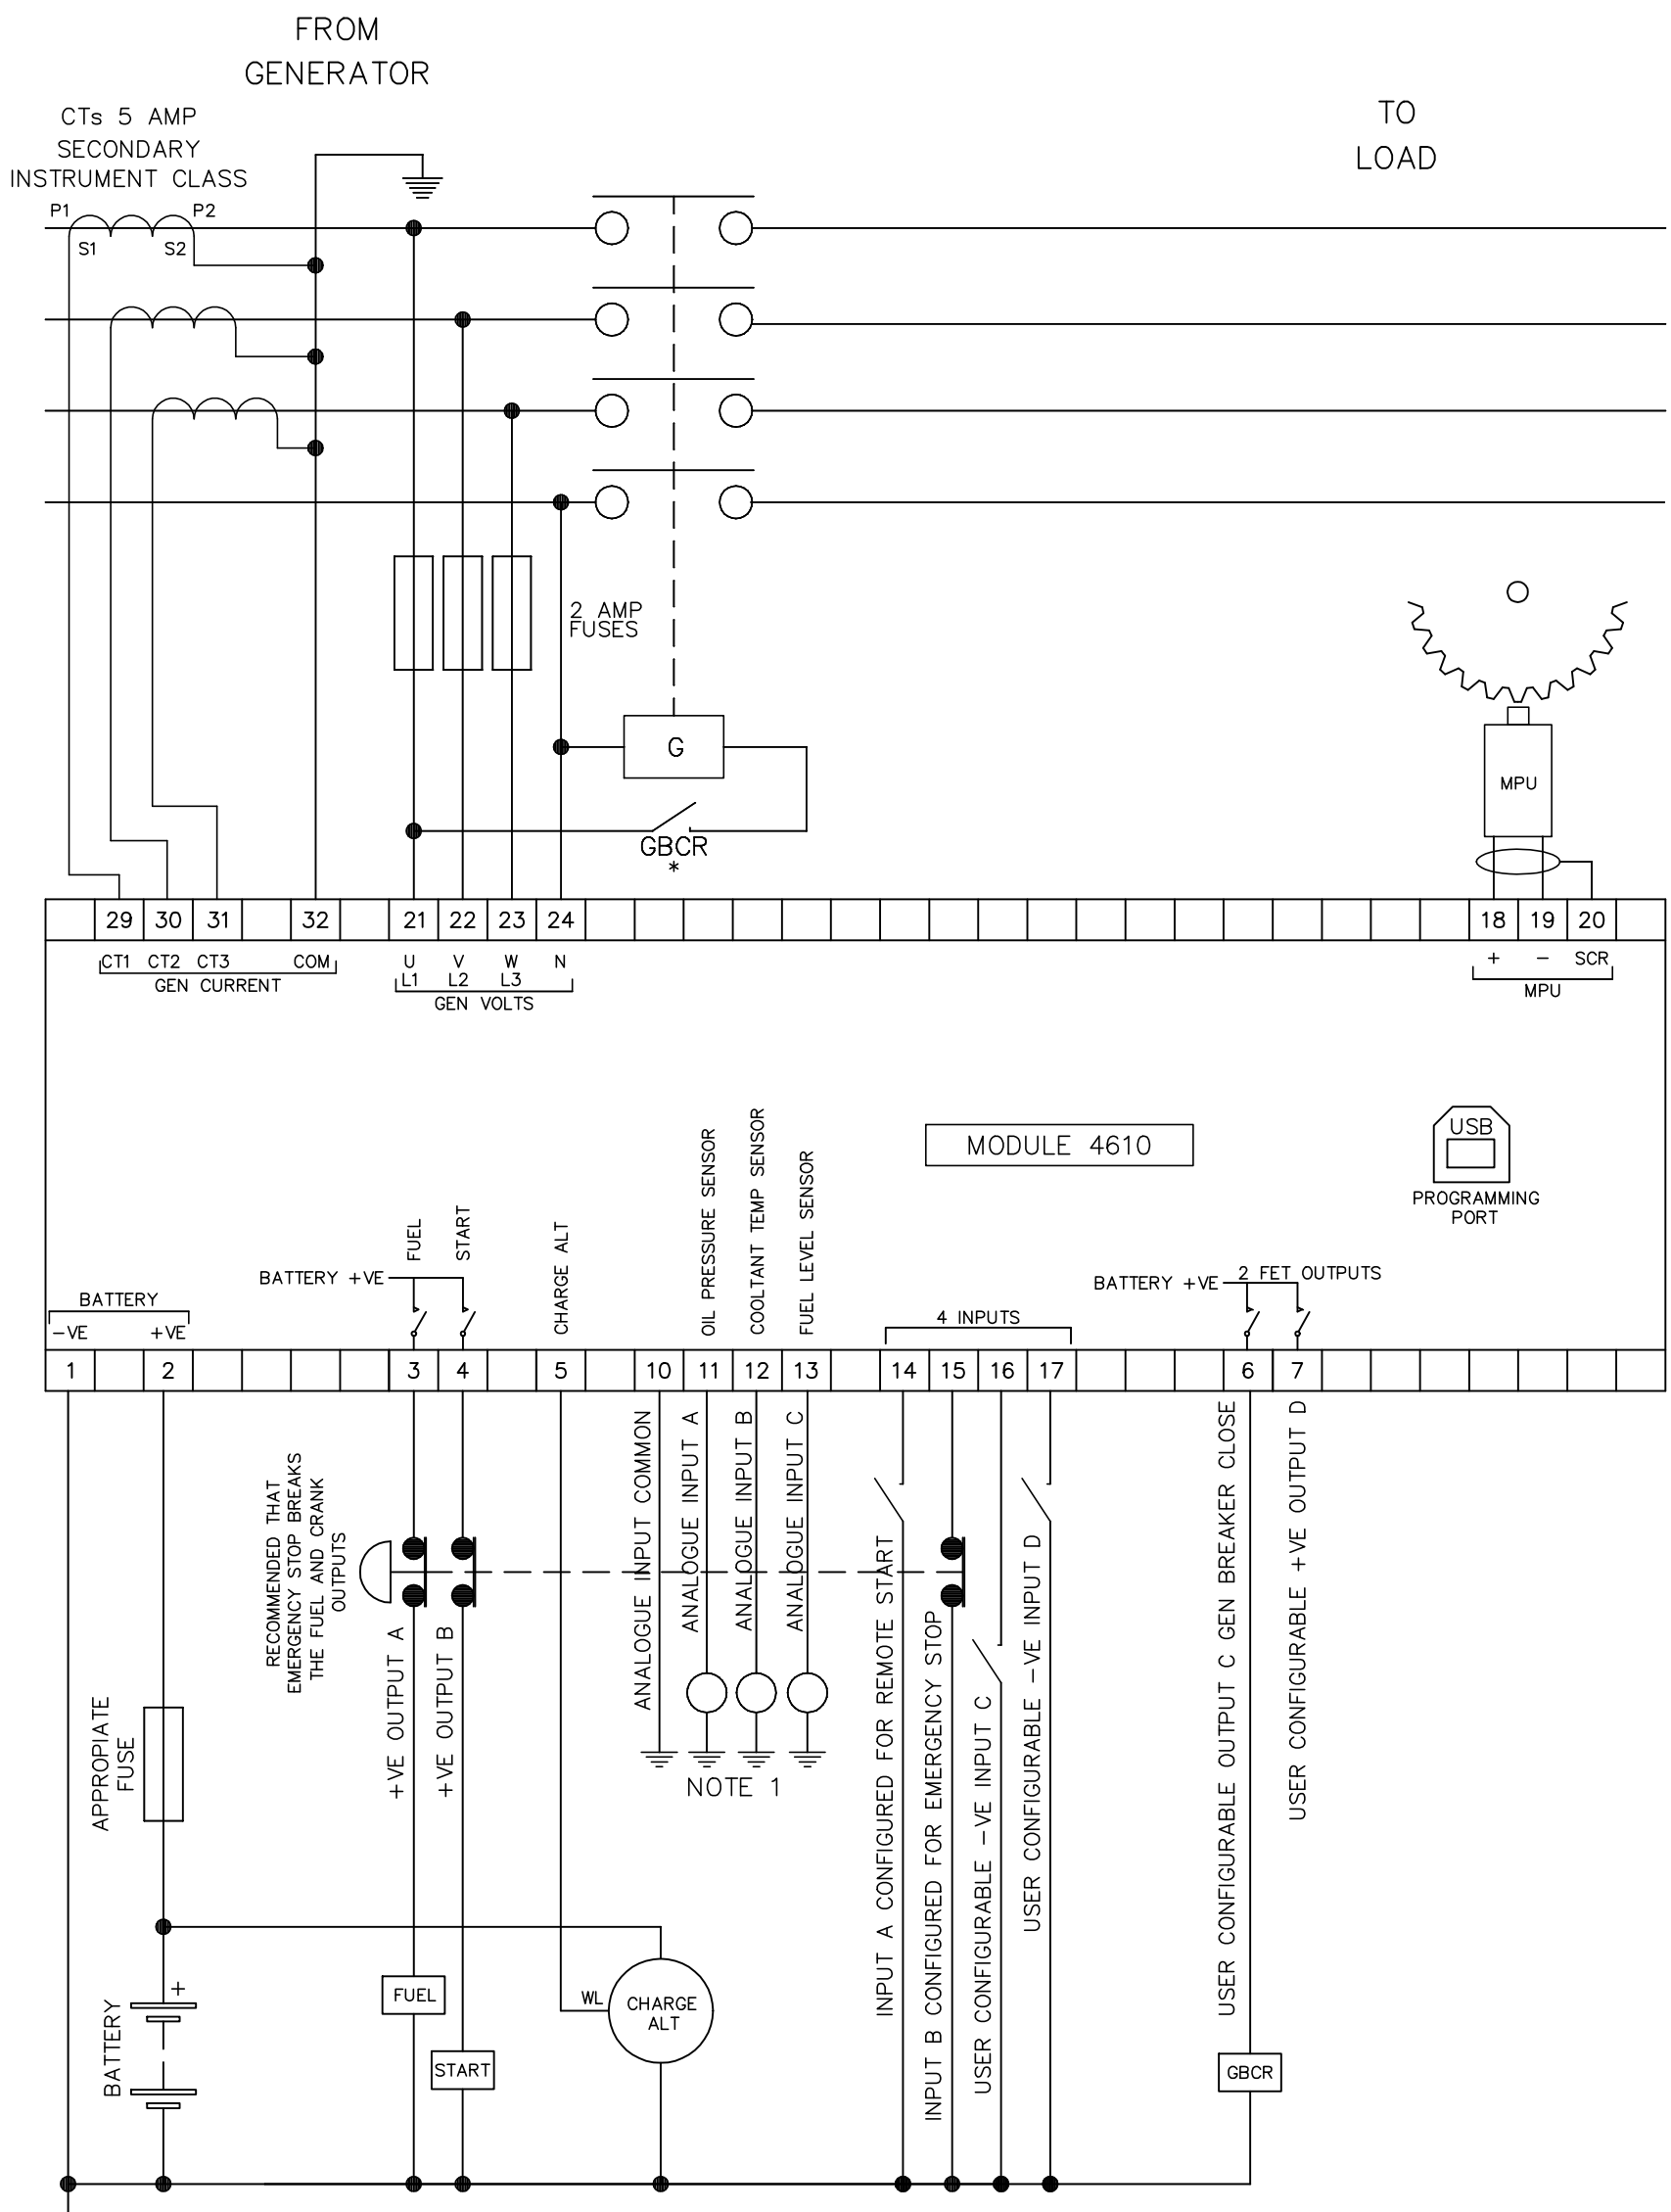

BATTERY NEGATIVE MUST BE GROUNDED

NOTE 1. THESE GROUND CONNECTIONS MUST BE ON THE ENGINE BLOCK, AND MUST BE TO THE SENSOR BODIES.

UNITS = NA				DSE — DEEP SEA ELECTRONICS PLC, HIGHFIELD HOUSE, HUNMANBY INDUSTRIAL EST., N. YORKSHIRE, YO14 0PH
TOLERANCE	REVISION	DATE		TITLE TYPICAL CONNECTIONS 4610
NA	CHK.			
	CHK. ADM	04/07/13	DWG No. 035−188	ISS No. 1 — SHEET 1/1
	DRN. AS	04/07/13		