



NOTE 1



BATTERY NEGATIVE MUST BE GROUNDED

NOTE 1: IF THE MODULE IS FIRST OR LAST UNIT ON THE RS485 LINK, IT MUST HAVE A 120 OHM TERMINATION RESISTOR FITTED ACROSS TERMINALS A AND B.

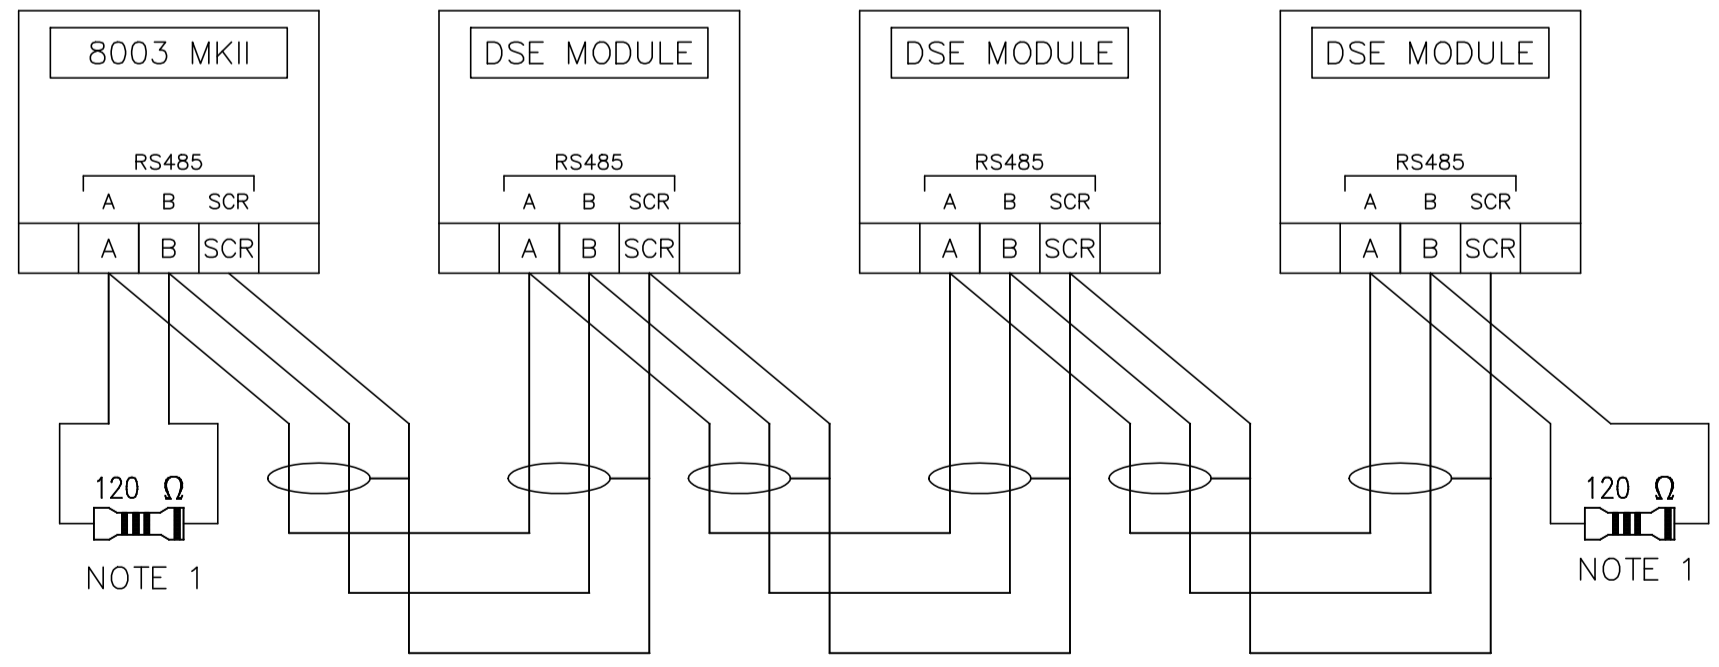

UNITS = NA				DSE		DEEP SEA ELECTRONICS PLC HIGHFIELD HOUSE HUNMANBY INDUSTRIAL EST. N. YORKSHIRE, YO14 0PH	
TOLERANCE	REVISION	DATE	TITLE		TYPICAL CONNECTIONS		
NA	APP.		8003 MKII				
CHK.	DRN.	AS	02/06/17	DWG No.	035-259	ISS No.	1 / 1