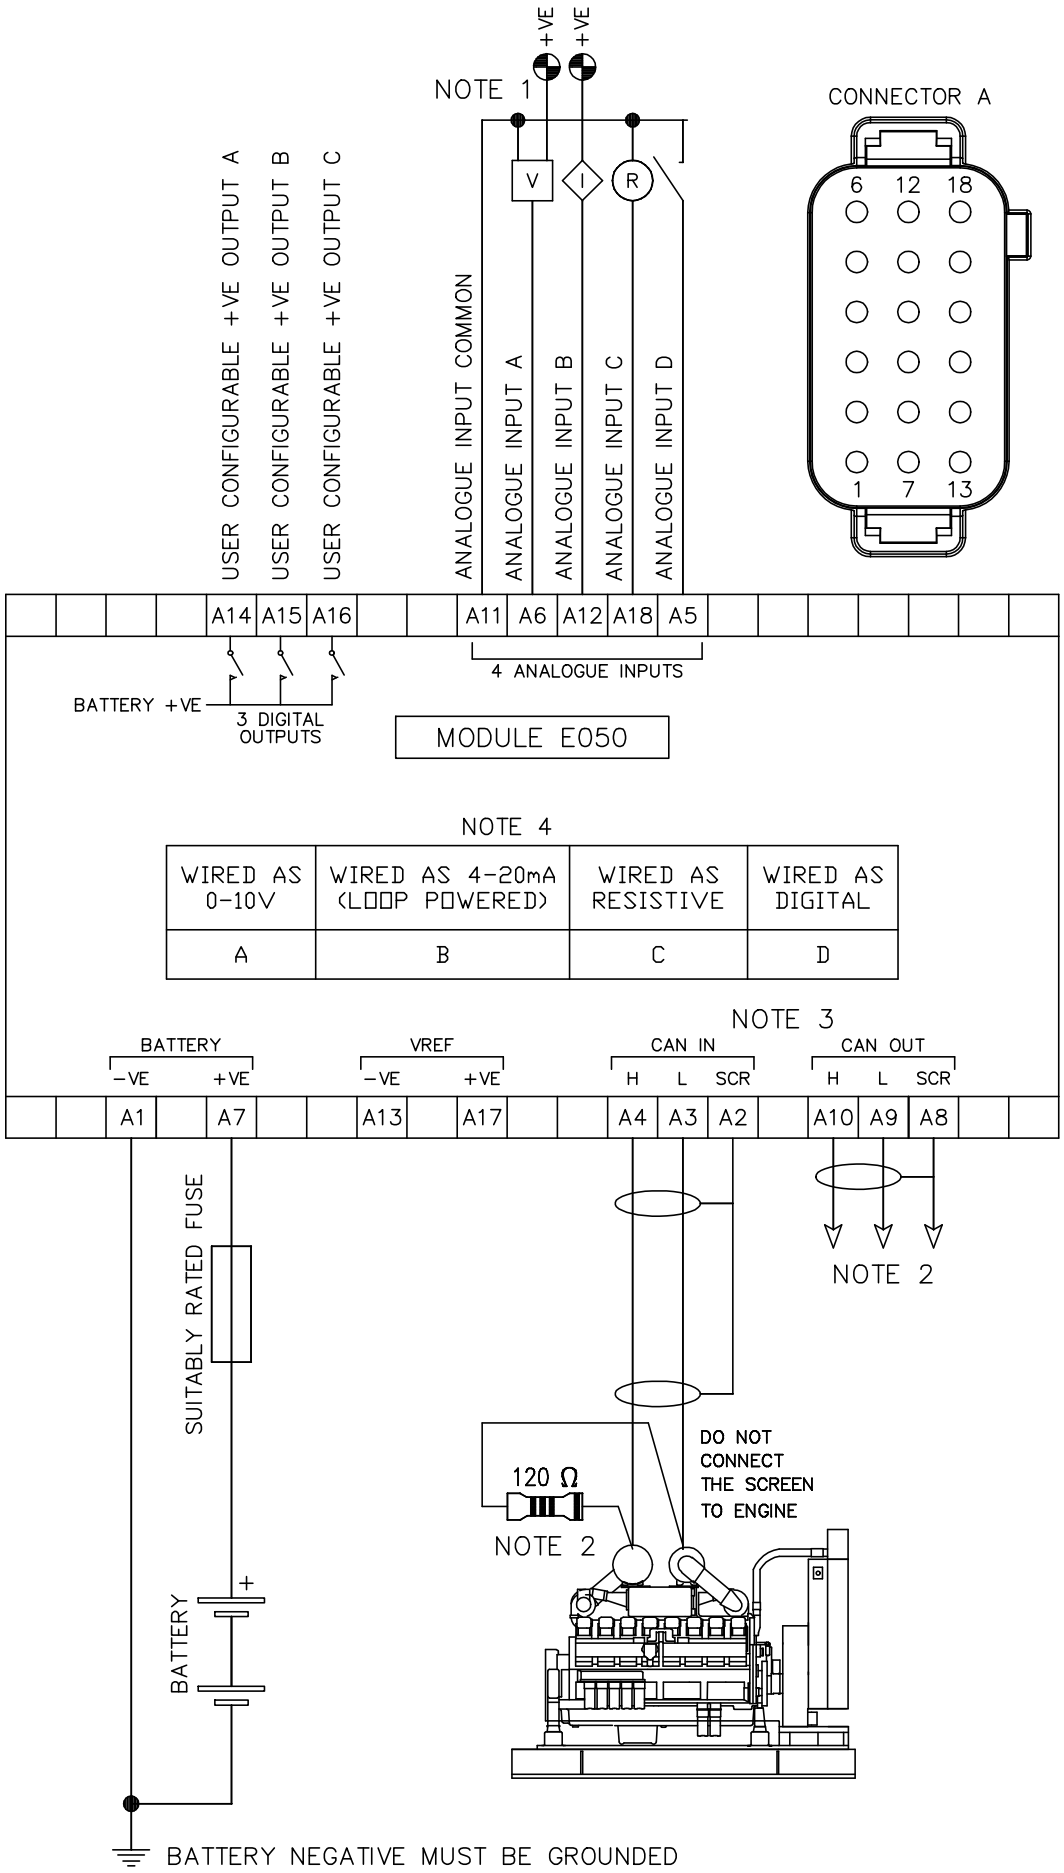

NOTE 1. ANALOGUE INPUT COMMON MUST NOT BE GROUNDED, IT IS LINKED INTERNALLY TO TERMINAL A1.

NOTE 2. 120 Ω TERMINATING RESISTOR MAY BE REQUIRED EXTERNALLY, SEE EXTERNAL EQUIPMENT MANUFACTURERS LITERATURE FOR FURTHER DETAILS.

NOTE 3. CAN IN AND CAN OUT ARE LINKED INTERNALLY.

NOTE 4. ANALOGUE INPUTS CAN BE CONFIGURED AS EITHER A DIGITAL INPUT, RESISTIVE INPUT, 0−10V INPUT, 4−20mA INPUT, OR ANY COMBINATION OF THE ABOVE.

UNITS = NA			DEEP SEA ELECTRONICS PLC HIGHFIELD HOUSE HUNMANBY INDUSTRIAL EST. N. YORKSHIRE, YO14 0PH
		AS 17/12/19	TITLE: TYPICAL CONNECTIONS E050
TOLERANCE	REVISION	DATE	
NA	CHK.		
	CHK.		DWG No. 035−273
	DRN. AS	23/07/18	ISS No. 7
			SHEET 1/1