

⚡ BATTERY NEGATIVE MUST BE GROUNDED


NOTE 1. THESE GROUND CONNECTIONS MUST BE ON THE ENGINE BLOCK, AND MUST BE TO THE SENSOR BODIES.

NOTE 2. 120 Ω TERMINATING RESISTOR MAY BE REQUIRED EXTERNALLY, SEE ENGINE MANUFACTURERS LITERATURE.

NOTE 3. ANALOGUE INPUTS CAN BE CONFIGURED AS EITHER A DIGITAL INPUT, RESISTIVE INPUT, 0-10V INPUT, 4-20mA INPUT OR ANY COMBINATION OF THE ABOVE.

NOTE 4. DIGITAL INPUTS CAN BE CONFIGURED AS EITHER +VE OR -VE SWITCHING.

NOTE 5. AN EXTERNAL 120 Ω TERMINATING RESISTOR MUST BE FITTED IF THE CONTROLLER IS THE FIRST OR LAST UNIT ON THE RS485 LINK

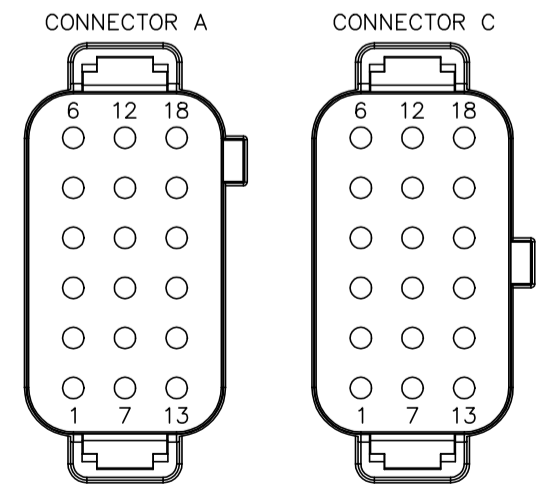

UNITS = NA	AS 17/09/15	DSE DEEP SEA ELECTRONICS PLC HIGHFIELD HOUSE HUNMANBY INDUSTRIAL EST. N. YORKSHIRE, YO14 0PH		
	AS 06/05/15			
	AS 26/02/15			
	JR 03/10/14			
	AS 13/01/14			
TOLERANCE	REVISION	DATE	TITLE	TYPICAL CONNECTIONS
NA	CHK.LS	06/05/15	E400	
	CHK.LS	26/02/15	DWG	
	DRN.IAS	27/11/13	No.	035-197
			ISS No.	6
			SHEET	1/1